

ORIGINAL FRAME SIZE 380 mm x 549 mm

THIRD ANGLE PROJECTION

FIG 1 FUSE ALARM (ONE PER RACK)

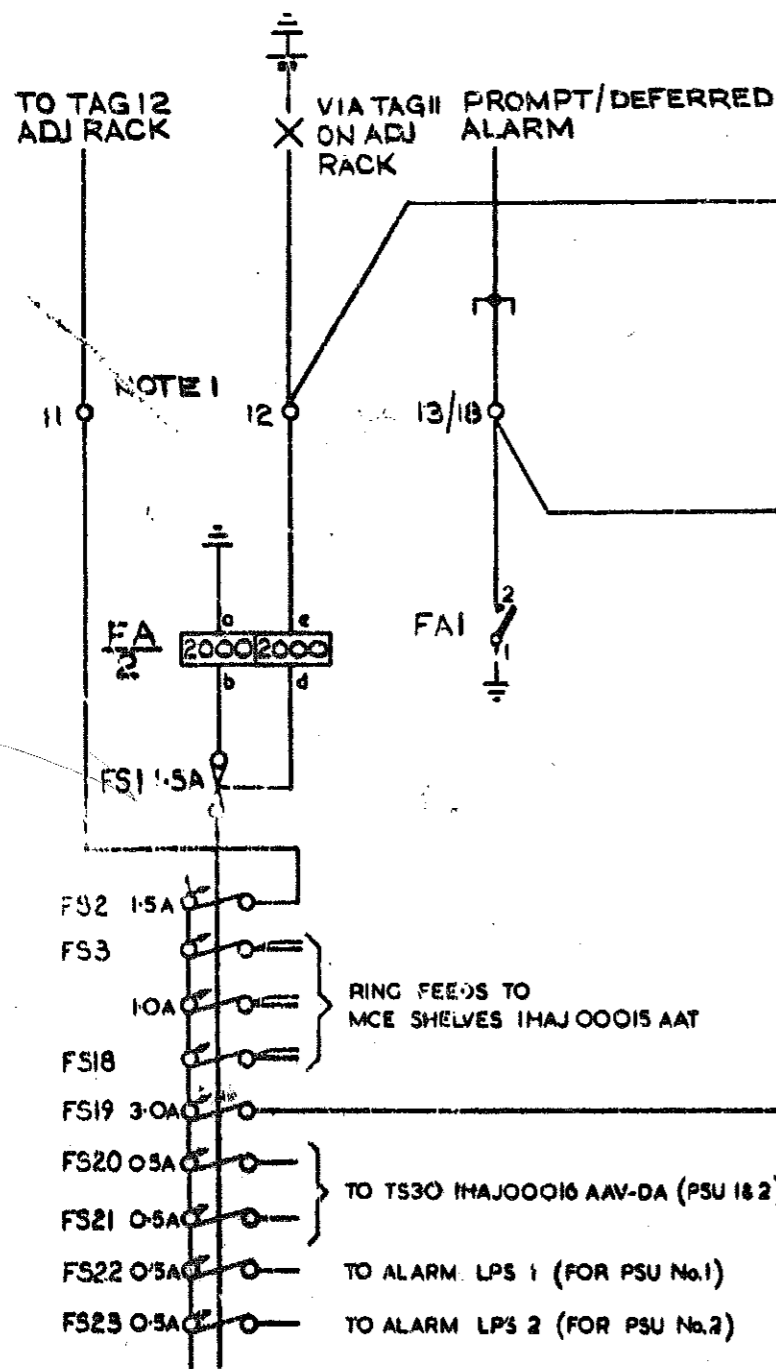


FIG 2 RACK ALARM LAMPS (ONE PER RACK)

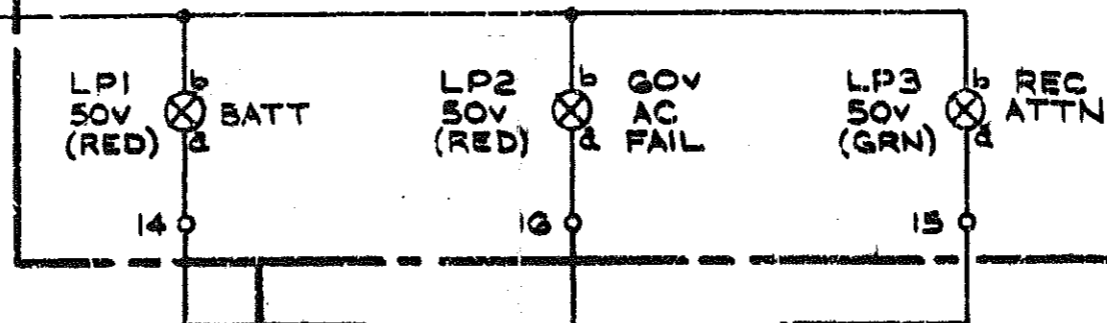


FIG 3 BATTERY JACK (ONE PER RACK)

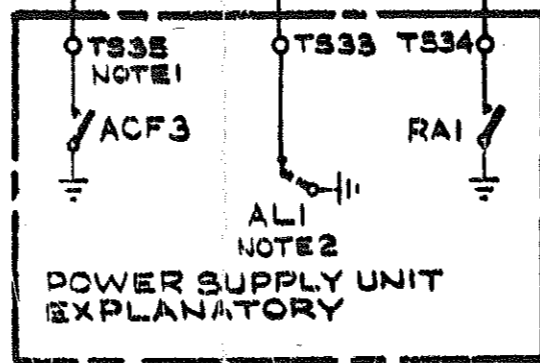
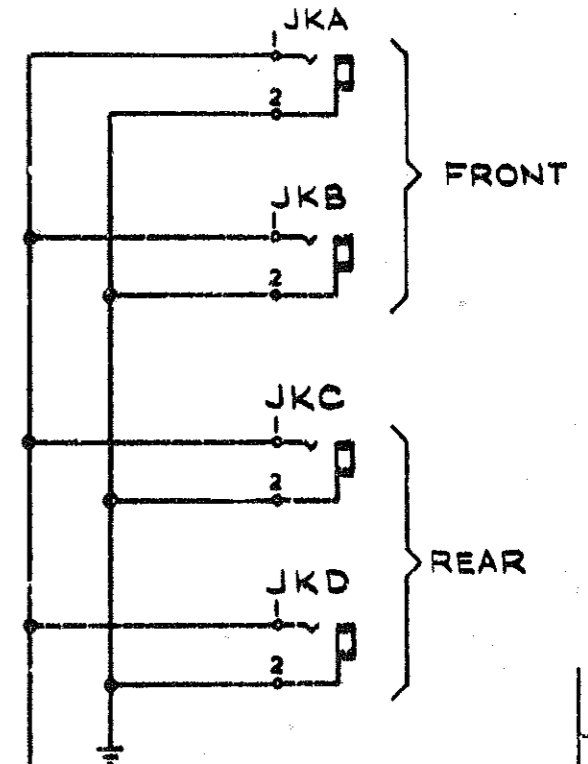


FIG 4 POWER SUPPLY UNIT (TWO PER RACK)

NOTES:-

1. TAGS PREFIXED TS ARE LOCATED ON POWER SUPPLY UNIT. ALL REMAINING TAGS ARE ON MISCELLANEOUS STRIP CONNECTION.
2. RELAY CONTACTS ALI ARE NORMALLY OPERATED.

DRN. SB		MATERIAL		FINISH		ORIGINAL SCALE	
A2	CKD. SM	RACK COMMON SERVICES		METER CONTROL EQUIPMENT.		REFERENCES SPEC D1000, T80.30 DRG 1HAJ00010AAV-DA TP 55615	
A3	CERTIFICATION KRL	AMENDMENT		1891E		AT 80130	
H700	DATE 20/4/82	BRITISH TELECOMMUNICATIONS HEADQUARTERS ES11-2-1					